

Supporting Information

Crown-Ether Appended Hexaazatrinaphthylene-Based Liquid-Crystalline Derivative showing Stimuli Response


Kyosuke Isoda ^{1,2*}, Keigo Shimooka ¹

¹ Faculty of Engineering and Design, Kagawa University, 2217-20 Hayashi-cho, Takamatsu, Kagawa 761-0396

² Health Research Institute, National Institute of Advanced Industrial Science and Technology (AIST), 2217-14 Hayashi-cho, Takamatsu, Kagawa 761-0395

* Correspondence: k-isoda@eng.kagawa-u.ac.jp; Tel.: +81-87-864-2395

This report was created by ACD/NMR Processor Academic Edition. For more information go to www.acdlabs.com/nmrproc/

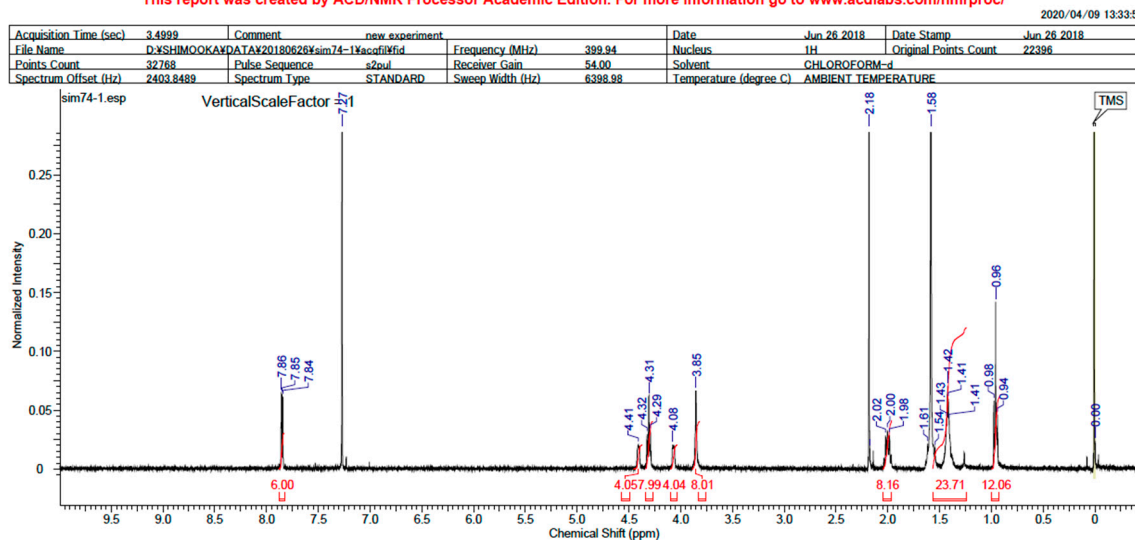

This report was created by ACD/NMR Processor Academic Edition. For more information go to www.acdlabs.com/nmrproc/


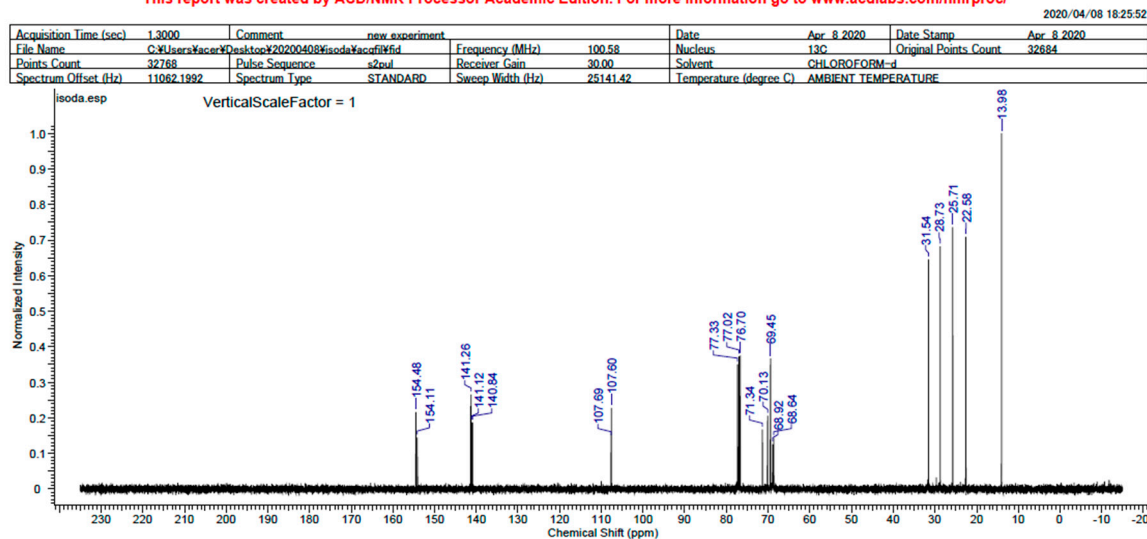


Figure 1. ¹H NMR and ¹³C NMR spectra of **16**.

This report was created by ACD/NMR Processor Academic Edition. For more information go to www.acdlabs.com/nmrproc/

Acquisition Time (sec)	1.3000	Comment	new experiment	Date	Feb 20 2020	Date Stamp	Feb 20 2020
File Name	D:\SHIMOOKA\NMR\20200220\simC12\crown13C\fid	Frequency (MHz)	100.58	Nucleus	¹³ C	Original Points Count	32768
Points Count	32768	Pulse Sequence	s2zul	Receiver Gain	60.00	Solvent	CHLOROFORM-d
Spectrum Offset (Hz)	11062.4824	Spectrum Type	STANDARD	Sweep Width (Hz)	25141.42	Temperature (degree C)	AMBIENT TEMPERATURE

2020/03/19 16:42:39

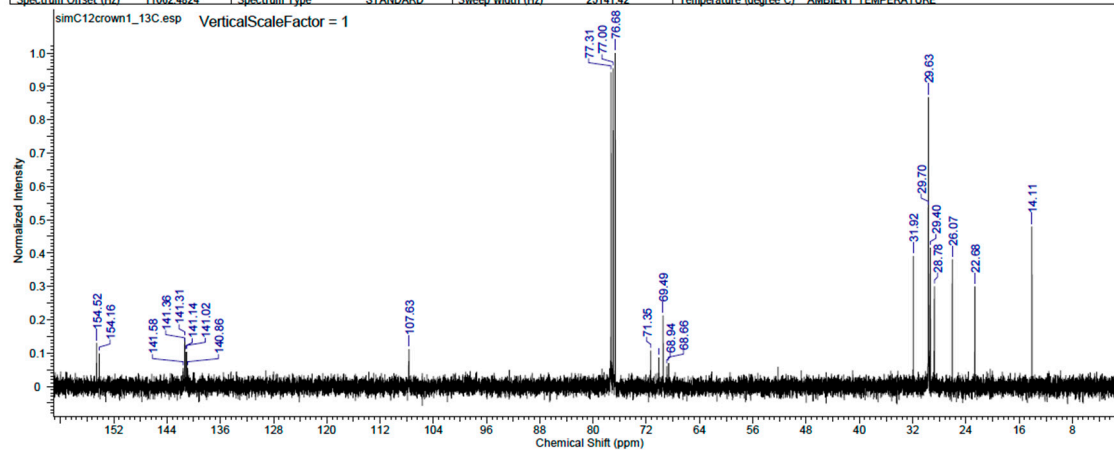

This report was created by ACD/NMR Processor Academic Edition. For more information go to www.acdlabs.com/nmrproc/

Acquisition Time (sec)	3.4999	Comment	new experiment	Date	Apr 19 2019	Date Stamp	Apr 19 2019
File Name	D:\SHIMOOKA\NMR\20190419\sim119\c12\fid	Frequency (MHz)	399.94	Nucleus	¹ H	Original Points Count	22396
Points Count	32768	Pulse Sequence	s2zul	Receiver Gain	10.00	Solvent	CHLOROFORM-d
Spectrum Offset (Hz)	2403.8489	Spectrum Type	STANDARD	Sweep Width (Hz)	6398.98	Temperature (degree C)	AMBIENT TEMPERATURE

2020/03/19 16:37:43

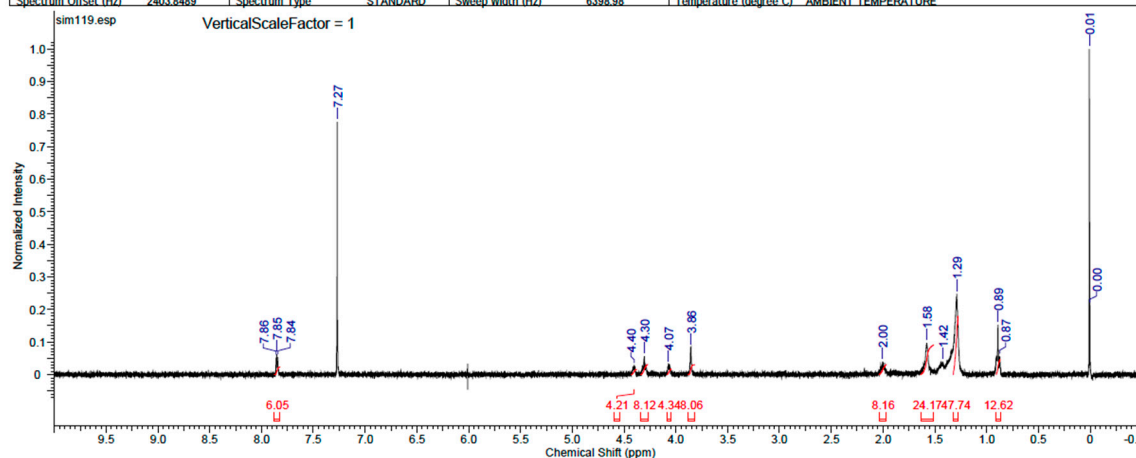


Figure 2. ¹H NMR and ¹³C NMR spectra of **112**.